
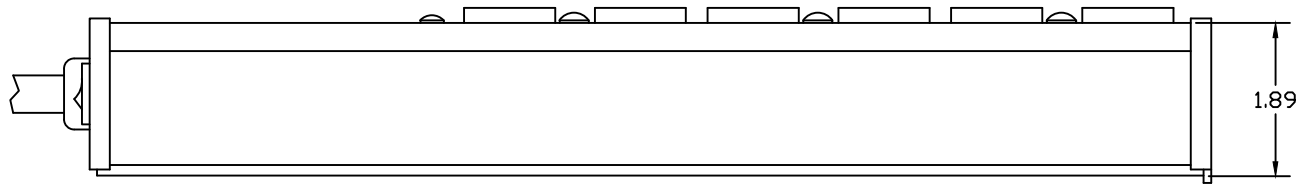


15 FT 14/3 SJT CORD WITH  
A 5-15HGP MOLDED PLUG

15 AMP CIRCUIT BREAKER

15A 125V HOSPITAL GRADE DUPLEX  
(3) REQUIRED

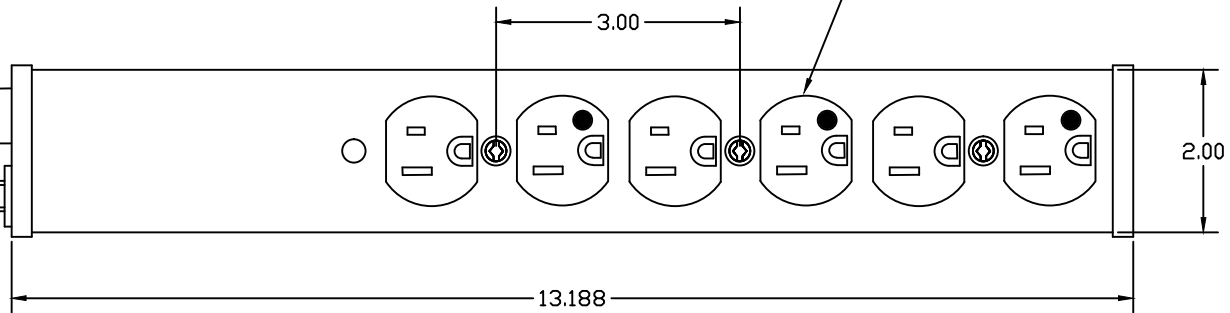

BPS HM 13-6-15